


5/8"; 3/4"; and 1" WATER METER INSTALLATION

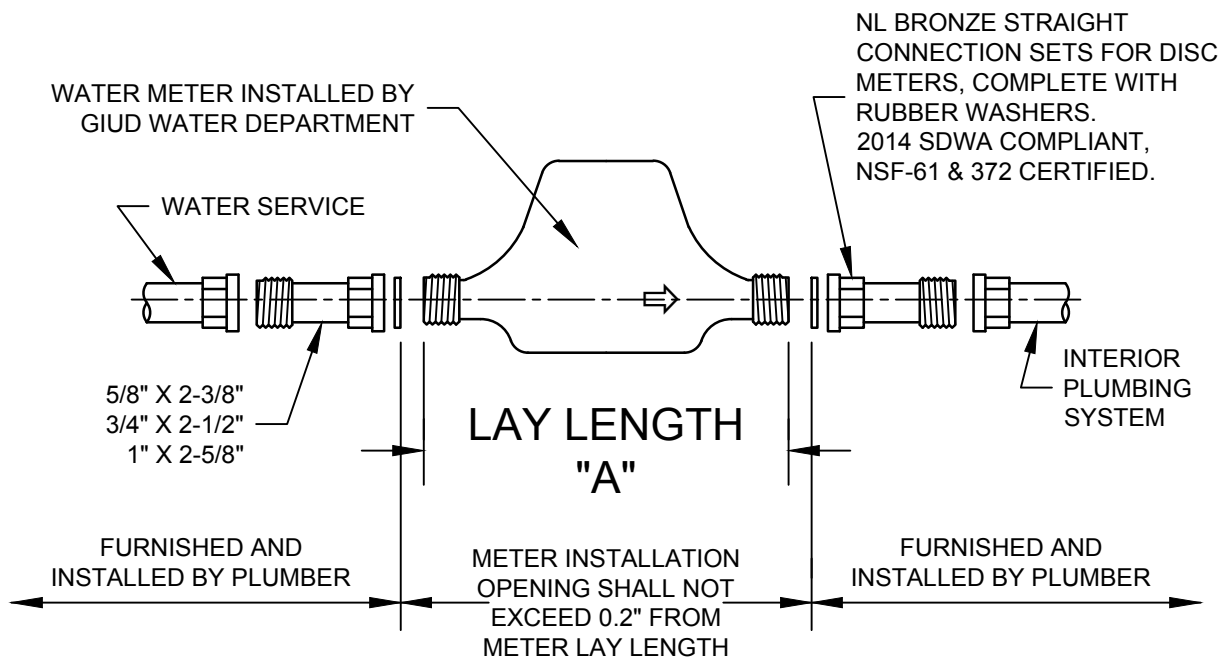

WATER METER SIZE			
	5/8"	3/4"	1"
DIMENSION "A"	7-1/2"	9"	10-3/4"

All meters, valves, piping and other appurtenances related to a meter installation are the property of the owner and shall be maintained by the owner. The GIUD Water Department may read, inspect or test a meter at any reasonable time or with such frequency as it deems advisable.

The Plumber shall be responsible for furnishing and installing all appropriate plumbing piping, fittings, couplings, unions, and hardware necessary for the installation of the water meter by the City of Grand Island Water Department, including but not limited to: the appropriate size, lead free, brass water meter unions used to install the water meter. Two unions are required to install one water meter.

Water meters shall be set level and in a horizontal position, at a minimum height of one (1) foot and a maximum height of three (3) feet and as near as possible to the point where the water service enters the building. Meters shall not be exposed to damage by freezing.

THIS DOCUMENT WAS
ORIGINALLY SEALED AND
ISSUED BY RYAN L. SCHMITZ
E 3818, ON 11-15-2019. THIS
MEDIA SHOULD NOT BE
CONSIDERED A CERTIFIED
DOCUMENT, AND SHOULD BE
USED FOR REFERENCE ONLY.

There shall be least 18-inches of clearance above and horizontally around the meter and kept readily accessible. If obstructions exist which interfere with meter installation, reading, testing, maintenance or removal, the GIUD Water Department may discontinue water service until the obstructions are removed.

Valves immediately upstream and downstream of the meter shall only be fully-port ball valves.