


SANITARY SEWER CROSSING OVER WATER MAIN

NO SCALE

JOINT ENCASEMENT AS PER STANDARD PLAN I33
*IF VERT. CLEARANCE IS LESS THAN 18" UNLESS SEWER PIPE JOINTS ARE WATER WORKS GRADE, 150 PSI RATED PER AWWA

ONE FULL LENGTH OF SANITARY SEWER PIPE SHALL BE INSTALLED CENTERED ON WATER MAIN CROSSING SO THAT JOINTS ARE AS FAR AS POSSIBLE FROM WATER MAIN FOR VERTICAL CLEARANCES OF 6"-18"

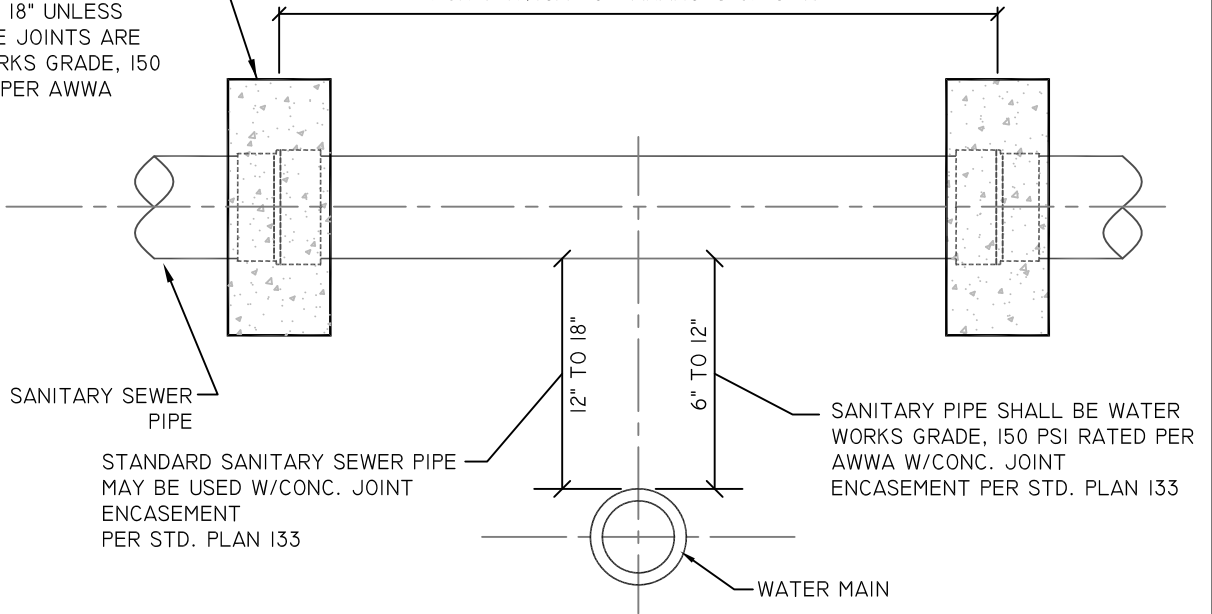


NOTE:
VERTICAL CLEARANCES UNDER 18" SHALL REQUIRE APPROVAL FROM THE UTILITIES DEPT.

NOTE:
WHEN MORE THAN 18" OF VERT. CLEARANCE EXISTS, STANDARD SANITARY SEWER PIPE MAY BE USED THROUGHOUT.

SANITARY SEWER CROSSING UNDER WATER MAIN

NO SCALE

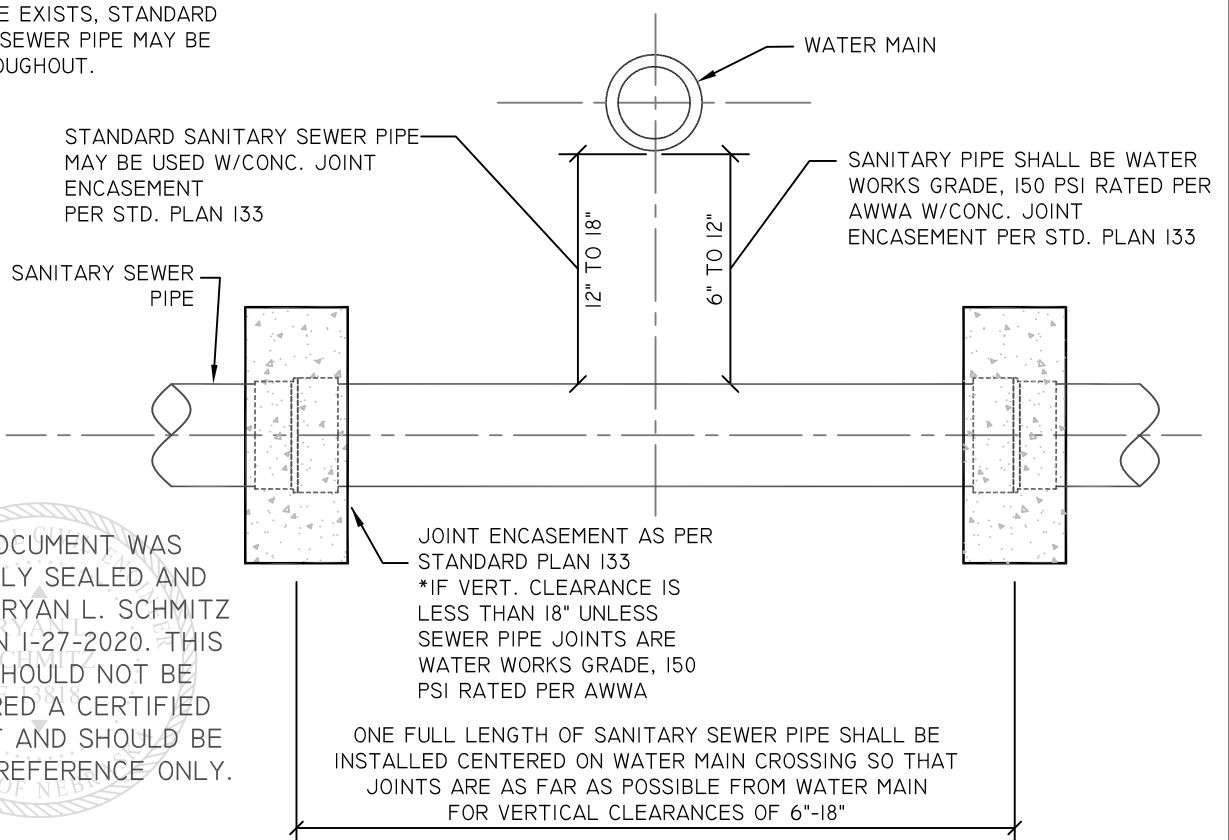

THIS DOCUMENT WAS ORIGINALLY SEALED AND ISSUED BY RYAN L. SCHMITZ E-13818, ON 1-27-2020. THIS MEDIA SHOULD NOT BE CONSIDERED A CERTIFIED DOCUMENT AND SHOULD BE USED FOR REFERENCE ONLY.