



## WATER MAIN CROSSING UNDER SEWER / DRAINAGE WAY

NO SCALE

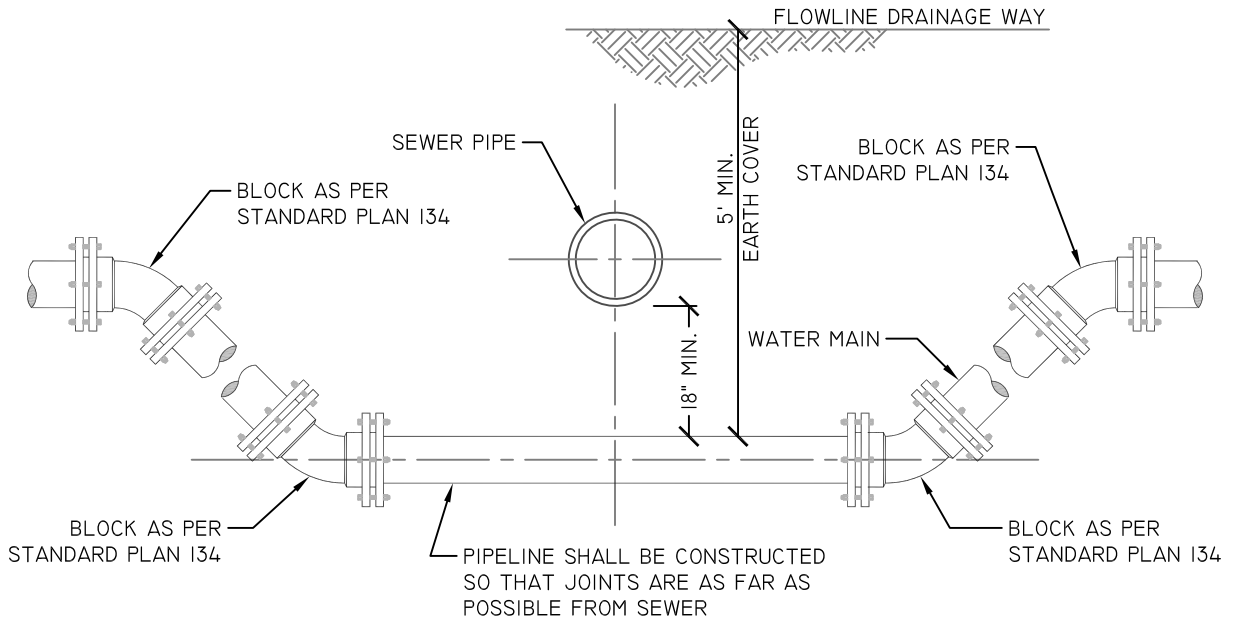

## WATER MAIN CROSSING OVER SEWER / DRAINAGE WAY

NO SCALE

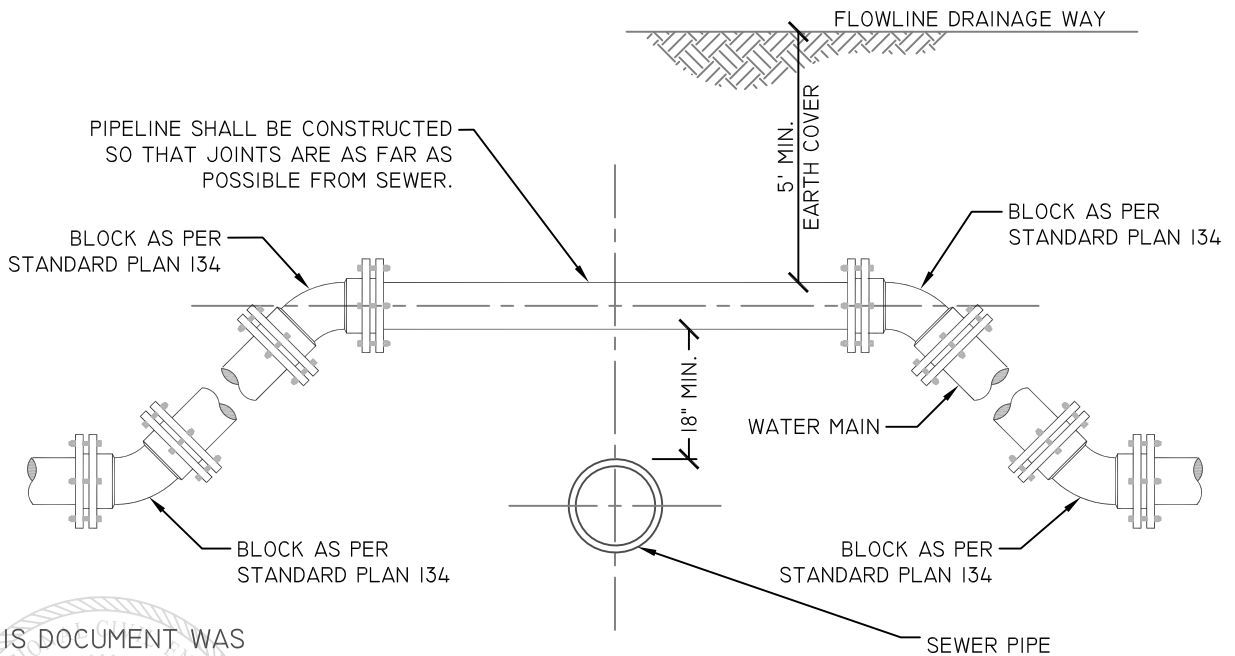

THIS DOCUMENT WAS  
ORIGINALLY SEALED AND  
ISSUED BY RYAN L. SCHMITZ  
E-13818, ON 1-27-2020. THIS  
MEDIA SHOULD NOT BE  
CONSIDERED A CERTIFIED  
DOCUMENT AND SHOULD BE  
USED FOR REFERENCE ONLY.

**NOTE:**

1. IN BOTH CONFIGURATIONS, THE USE OF RETAINER GLANDS INSTEAD OF OR IN ADDITION TO THRUST BLOCKS MAY BE ACCEPTABLE AT THE DIRECTION OF THE UTILITIES DEPT.
2. FOR 12" AND LARGER WATER MAINS, 22 1/2° BENDS SHALL BE USED FOR VERTICAL DEFLECTIONS